

Kabul Edilmiş Araştırma Makalesi (Düzenlenmemiş Sürüm)

Accepted Research Article (Uncorrected Version)

Makale Başlığı / Title

Investigation of concrete compressive strength of existing buildings depending on number of core samples

Mevcut binalarda beton basınç dayanımının karot sayısına bağlı değişiminin incelenmesi

Yazarlar / Authors

Mehmet İNEL¹, Bayram Tanık ÇAYCI^{2*}, Hayri Baytan ÖZMEN³

Referans No / Reference No

PAJES-00236

DOI

10.5505/pajes.2018.00236

Bu PDF dosyası yukarıda bilgileri verilen kabul edilmiş araştırma makalesini içermektedir. Sayfa düzeni, dizgileme ve son inceleme işlemleri henüz tamamlanmamış olduğundan, bu düzenlenmemiş sürüm bazı üretim ve dizgi hataları içerebilir.

This PDF file contains the accepted research article whose information given above. Since copyediting, typesetting and final review processes are not completed yet, this uncorrected version may include some production and typesetting errors.



Concrete strength is one of the most critical parameters the seismic performance of reinforced concrete constructions. Common methods to determine the concrete compressive strength take core samples from structural members. However, the number of core samples based on the size of the construction is important for reliable results, especially in old constructions. This study investigate the possibility of determination of the concrete compressive strength values of existing buildings using lower number of cores. For this experimental results of core samples taken from 148 sets moderately damaged reinforced concrete buildings during 2011 Earthquake. Concrete compressive strength values based on 15 sets obtained by using 50% and 70% of the core sample building are compared. The compressive strength values of all core samples to investigate accuracy of estimation of concrete strength with using lower number of core samples. The study investigates whether there is a significant difference between taken from a single story (i.e. ground story) and the other stories of the building. It is concluded that the use of %50 of the required core samples is possible for the rapid assessment of the field investigation studies when the obtained concrete strength is equal to or greater than 8 MPa. However, additional core samples to complete 70% of the required samples are required for concrete strength values less than 8 MPa.

! j a @ j ° 1; "XS"µi @zš © · (š 2, Hacı Baytan, ÖZMEN

^{1,2}Department of Civil Engineering, Engineering Faculty, Pamukkale University, Denizli, Turkey.

minel@pau.edu.tr, bcayci@pau.edu.tr

³Department of Civil Engineering, Engineering Faculty, Pamukkale University, Denizli, Turkey.

fourthauthor@mail.address

Received / İletildiği Tarih : 30.07.2018; Accepted / Kabul Tarihi 13.12.2018

* Corresponding author / İletişim Yazarı

doi: 10.5505/pajes.2018.236

Research Article / Araştırma Makalesi

Abstract

Concrete strength is one of the most critical parameters the seismic performance of reinforced concrete constructions. Common methods to determine the concrete compressive strength take core samples from structural members. However, the number of core samples based on the size of the construction is important for reliable results, especially in old constructions. This study investigate the possibility of determination of the concrete compressive strength values of existing buildings using lower number of cores. For this experimental results of core samples taken from 148 sets moderately damaged reinforced concrete buildings during 2011 Earthquake. Concrete compressive strength values based on 15 sets obtained by using 50% and 70% of the core sample building are compared. The compressive strength values of all core samples to investigate accuracy of estimation of concrete strength with using lower number of core samples. The study investigates whether there is a significant difference between taken from a single story (i.e. ground story) and the other stories of the building. It is concluded that the use of %50 of the required core samples is possible for the rapid assessment of the field investigation studies when the obtained concrete strength is equal to or greater than 8 MPa. However, additional core samples to complete 70% of the required samples are required for concrete strength values less than 8 MPa.

Keywords: Concrete compressive strength, Core, Reinforced concrete building

Öz

Concrete strength is one of the most critical parameters the seismic performance of reinforced concrete constructions. Common methods to determine the concrete compressive strength take core samples from structural members. However, the number of core samples based on the size of the construction is important for reliable results, especially in old constructions. This study investigate the possibility of determination of the concrete compressive strength values of existing buildings using lower number of cores. For this experimental results of core samples taken from 148 sets moderately damaged reinforced concrete buildings during 2011 Earthquake. Concrete compressive strength values based on 15 sets obtained by using 50% and 70% of the core sample building are compared. The compressive strength values of all core samples to investigate accuracy of estimation of concrete strength with using lower number of core samples. The study investigates whether there is a significant difference between taken from a single story (i.e. ground story) and the other stories of the building. It is concluded that the use of %50 of the required core samples is possible for the rapid assessment of the field investigation studies when the obtained concrete strength is equal to or greater than 8 MPa. However, additional core samples to complete 70% of the required samples are required for concrete strength values less than 8 MPa.

Anahtar Kelimeler: Betonun basınç dayanımı, Çerçeve beton yapılar

1 Introduction

Concrete compressive strength is one of the most important parameters affecting the seismic performance of reinforced concrete constructions [1]. Thus, the estimation of concrete compressive strength values as close as possible to actual values is of great importance for seismic performance evaluation of reinforced concrete buildings. Taking core samples is widely used to determine concrete compressive strengths of reinforced concrete buildings. However, determining the number of cores used to estimate the concrete compressive strength is a significant problem in old structures where production quality can vary greatly in terms of the story and/or members. In structures built using the hand casting technique, obtaining a certain concrete standard is difficult. Concrete quality can be reduced due to the

negligence in the curing of the concrete. Moreover, concrete quality may be lower at upper stories due to difficulties encountered in transportation to a higher level [2].

As well as all these uncertainties, some difficulties are encountered while taking core samples from residential buildings because it is a destructive method. Taking many concrete samples from existing buildings causes discomfort for the inhabitants and can be detrimental for the members. Therefore, determining the concrete compressive strength of the building by using a minimum number of core samples is important.

The requirements may change according to building codes. The usual requirement is to take at least 3 core samples for each story of the building (FEB 3) Eurocode [4] TEC-2007 [5]. However, special requirements may be permitted

to minimize the discomfort for the inhabitants. Turkish Risky Building Detection Code [6] allows the use of concrete compressive strength values estimated by core samples taken from a single story for seismic risk evaluation studies. The purpose of Turkish Building Detection code is not the performance assessment of buildings. It is used to determine whether the investigated building is risky or not. Thus, taking core samples only from specific story (the ground story for most of case) is acceptable process to be fast and inexpensive method. But taking core samples in specific story is also questionable whether it can reflect or not the concrete compressive strength of whole building.

This study aims to investigate the possibility of determination of the concrete compressive strength values of existing buildings using lower number of core samples than the required number of cores. For this purpose, experimental results of core samples taken from damaged reinforced concrete buildings during 2011 Simav Earthquake as a part of joint project by Pamukkale University and the Disaster and Emergency Management Presidency [7] were used. The samples were taken from slightly and moderately damaged buildings as shown in Figure 1. The variation of determined concrete compressive strengths, depending on the number of core samples taken from reinforced concrete buildings are investigated. The study also evaluates the correlation of concrete samples taken from different stories and whether there was a significant difference between samples taken from a single story (i.e. ground story) compared to the overall structure.



Figure 1. Concrete core sampling from the examined buildings

2 Simav earthquake

An earthquake with a magnitude of 5.7 (ML) has struck Simav, Kutahya located in the western part of Turkey on May 19, 2011 at 20:15 (GTM) (Figure 2). The earthquake indirectly caused 3 casualties and more than 70 injuries. The ground motion has been strongly felt by approximately 135.000 people and caused observable damage around a maximum of 25 km radius from the epicenter. Although the magnitude of earthquake is moderate, the effects of the earthquake on the structures are serious [0]. The number of damaged and collapsed buildings around Simav is given in Table 1. More detailed information about the damages may be obtained from the study by Inel et al., 2013 [1].

3 Methodology

Compressive strength of reinforced concrete buildings was investigated using core samples taken from buildings damaged at different levels during 2011 Simav Earthquake. In the current Turkish Earthquake Code (2007) [5] the minimum number of core samples is specified based on knowledge level that accounts the uncertainty in the collection of as-built building data. Three knowledge levels are considered in the TEC documents. Core samples for reinforced buildings in Simav TEC-2007 that requires minimum 3 core samples from each story. Concrete compressive strength values were calculated for 15 different sets, obtained by using the 50% and 70% of the total number of samples for each building. There is a high number of possibilities to select 15 core sample sets. For example, in a building where 8 samples were taken, 7 of these samples were randomly selected to form 3 different sets for 70% of core samples. Similarly, 15 different sets were formed by including 9 random samples for 50% of samples. The average and standard deviation values obtained from all sets were compared with those obtained from 15 different sets using 70% and 50% samples. The main reason of creating these sets is to investigate possibility of determination of concrete compressive strength of whole building reasonably by using lower number of core samples taken from investigated buildings (50% and 70% for this case).

Some building codes may permit using the concrete compressive strength values estimated by the core samples taken from a single story for seismic risk evaluation. As it is a destructive method, taking samples from a single story is appealing to minimize the discomfort. Therefore, in addition to the effect of the number of core samples, the correlation of the strength values obtained from samples taken from different stories across the overall construction is also investigated. For this purpose, the average concrete strength values obtained using core samples taken from different stories are compared to the value obtained using core samples from the whole building.

Table 1. The number of damaged and collapsed buildings around Simav

Region	Damage State				
	Collapse	Heavy	Moderate	Light	None
Simav City	5	331	261	1531	2265
Simav Towns & Villages	104	929	125	2759	3254
İzmir	3	79	6	337	64
W.S. - M.S. A	2	46	7	290	153
Pazarlar	1	56	10	255	43

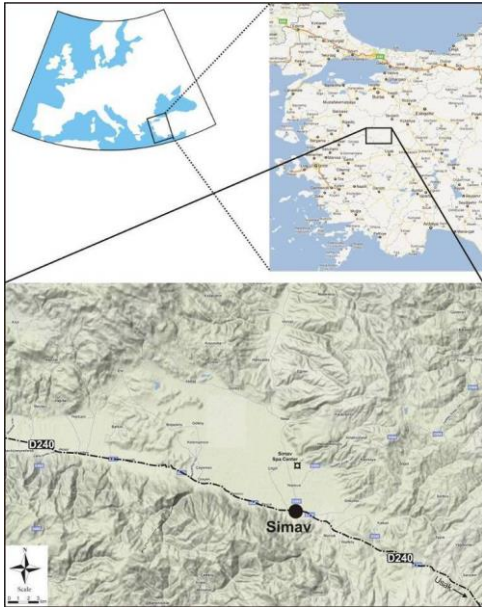


Figure 2 Location map of the study area [8]

4 Building data

The determination of compressive strength of the concrete is especially important for existing buildings that are constructed regardless of seismic design principles. Also, in existing buildings in Turkey the used concrete was prepared at the construction site with handmade techniques preventing a standard outcome. These types of buildings constitute the majority of the risky buildings that need seismic risk assessment. Therefore, the investigation on the concrete strength variability using the existing buildings is important. The buildings slightly or moderately damaged after May 19, 2011 Simav earthquake [10], offers an important possibility for such an investigation.

The majority of reinforced concrete buildings examined in the study were low and mid-rise residential buildings built using the handmade concrete. These buildings were constructed before the 1998 Turkish Earthquake Code which is the first comprehensive code in Turkey in terms of many seismic resistance principles. As the majority of investigated buildings were built in 1980s, it is expected that the characteristic concrete compressive strength value is 14 MPa that corresponds to B160 concrete for residential buildings.

The distribution of the number of buildings with respect to the number of stories is shown in Figure 3. The figure obviously shows that the majority of buildings have 4 or 5 stories.

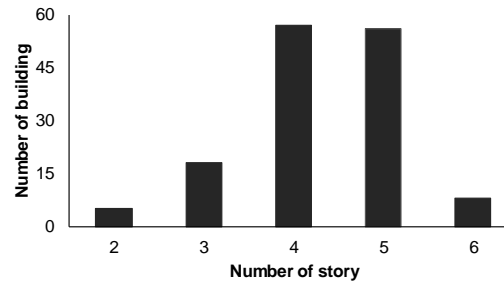


Figure 3. Distribution of the number of story of the investigated building set

The distribution of average concrete compressive strengths of 148 damaged buildings is shown in Figure 4. Using three core samples per each story. When the figure is examined, it is observed that the average concrete compressive strength value of many buildings was below 10 MPa. This seems to be an expected observation considering the date of construction of the buildings and handmade concrete.

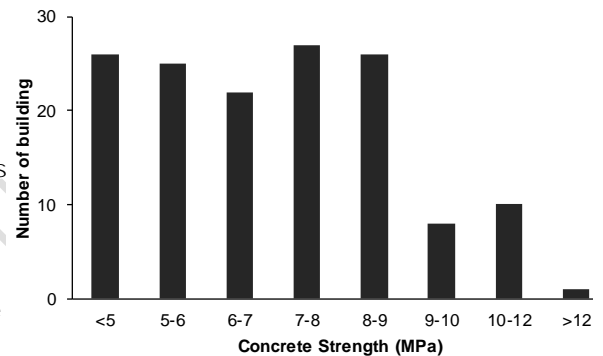


Figure 4. Distribution of average concrete compressive strengths

5 Analysis results

Compressive strength values of each building were determined based on 3 core samples for each story. Samples were taken and tested according to TS 10465 (1992) as stated in TEC-2007. Compressive strength test results of each core sample were corrected with height/dimension ratio coefficient defined in ASTM C42/C 42R standard [14]. Concrete compressive strength of building was determined by subtracting the standard deviation from the average of core samples.

Since this study aims to evaluate the possibility of determining the concrete compressive strength of buildings with a lower number of cores than the code requirements. For this purpose, the concrete strength of randomly obtained different sets using 50% and 70% of required core samples were compared to the concrete strength of the building obtained using 3 core samples from each story. The random selection is used for the effect of core sample location on the concrete strength when 50% and 70% of core samples are used to evaluate the effect for the number of samples. Besides, the concrete strength values of core samples taken from a single story is also compared to the building concrete strength values.

Figure 5 plots the variation of concrete compressive strength of randomly selected 15 sets of average compressive strength of each building. The horizontal axis represents the concrete

strength ranges of the buildings 4-6 MPa, 6-8 MPa, 8-10 MPa and greater than 10 MPa. Therefore, each horizontal point includes 15 randomly selected data set times number of buildings within the considered concrete strength. Although there are buildings with concrete strength lower than 4 MPa, they are not considered as meaningful. The vertical axis plots the ratio of compressive strength of randomly selected samples to compressive strength of the building considering all data. Figure 5 (a) and Figure 5 (b) show the variation for 50% and 70% of samples respectively. The box plot borders illustrate average minus standard deviation, average and average plus standard deviation values. Figure 5 indicates that both 50% and 70% of core samples have similar trend for concrete strength estimates. The compressive strength ratio range between 0.57 and 2.62 for 50% of core samples while the ratio change from 0.57 and 1.84 for 70% of core samples. The significant scatter is obvious for the lower concrete strength values. The scatter decreases as the concrete strength values and number of core samples increase. The decrease in variation is more obvious for samples having concrete compressive strength values higher than 8 MPa. Although there is not a significant change in the average concrete compressive strength values, it can be seen that the standard deviation values (scatter) decreases approximately 10% for both groups as the concrete compressive strength values increase.

Assuming that 15% deviation from the building concrete strength using the required number of core samples is reasonable, the concrete strength estimates using lower number of core samples are evaluated. Figure 6 compares the compressive strength ratio of 50% and 70% of core samples with building averages. Red lines indicate the 0.85 and 1.15 values of compressive strength ratio. Table 2 lists the percentage of compressive strength ratios within the 0.85 and 1.15 values. The estimation success of 50% and 70% of core samples with 15% deviation is 80% and 94% respectively. It is obvious that the deviation is more significant for the lower building concrete strength values. Therefore Table 2 also illustrates the estimation success for the concrete strength values lower than 8 MPa and 8 MPa or higher than 8 MPa, separately. The use of lower number of core samples depends on the building concrete strength. When the building concrete strength is equal to or higher than 8 MPa, both 50% and 70% of the required core samples provide reasonable result; 90% and 98.7% of estimates are within 15% deviation limits for 50% and 70% of the required core samples, respectively. However, the percentage of the concrete strength estimates within 15% deviation limits are 70% when 50% of the core samples is used. It is recommended that the 50% of the required core sample may be used for the rapid assessment or large field investigation studies when the obtained concrete strength is equal to or greater than 8 MPa. However, it is recommended to add core samples to complete 70% of the code required samples are required for concrete strength values lower than 8 MPa.

Table 2. Percentage of concrete strength estimates within %15 deviation

Concrete strength	50%	70%
<8 MPa	70%	90.5%
≥8 MPa	90%	98.7%

Average	80%	94.5%
---------	-----	-------

As mentioned in Section 2, some building codes may permit the use of strength values estimated by the core samples taken from a single story, that is usually the ground story for most cases [6]. Additionally, concrete compressive strength may be lower at upper stories due to difficulties encountered in transportation to a higher level for old buildings constructed without concrete pumps. Thus, the concrete strength at the upper stories may be expected to be lower than the building average values. Moreover, when the inferior construction capabilities and the time needed to wait for stripping slab formwork is considered, erection of a single story building may last for many months. Seasons may change during this time and the changing in temperature and the weather conditions may affect the curing and strength of the concrete. Therefore, the change of concrete strength with respect to story levels may be of attention.

Figure 7 plots the ratio of concrete strength of ground floor (Figure 7a) and top floor (Figure 7b) to the building concrete strength. Significant and similar scatter is obvious for both ground and top stories. Besides the scatter is independent from the building concrete strength values. The concrete strength based on core samples from a single story (ground or top) ranges approximately between 47% and 175% of the concrete strength based on samples taken from throughout the building. The percentage of concrete strength values within the 15% deviation range are 59.7% for ground story and top story, respectively. Both ground and top stories have similar scatter.

Considering the scatter and the values above mentioned, it is hard to say that the concrete compressive strength values based on a single story core samples are reliable. The outcomes indicate that taking core samples from specific story as described in Turkish Risky Buildings Detection Code may be inadequate to reflect the concrete compressive strength of the building. Instead of taking core samples from a single story, the use of 50% or 70% of the code required core samples from all stories is much more effective and reliable.

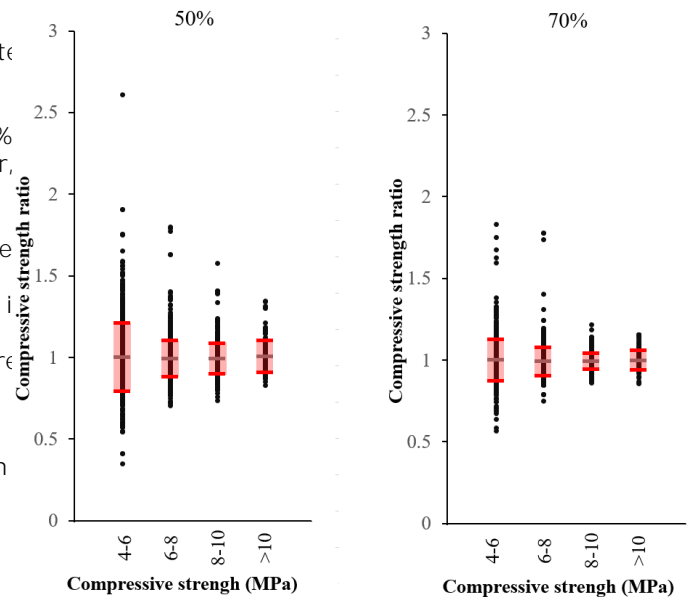


Figure 5 Concrete compressive strength ratio of 50% and 70% of set to the compressive strength of building with all samples

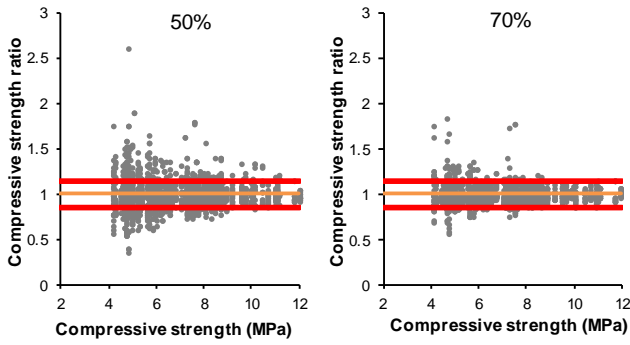


Figure 6 Concrete compressive strength ratios of 50% and 70% of sets to the compressive strength of building with all samples

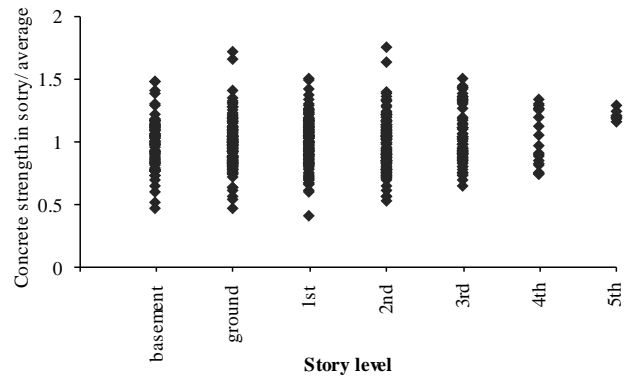


Figure 7 Ratio of concrete compressive strength in a story to the building average value

Figure 8 illustrates the ratio of concrete compressive strength based on the specific story to the compressive strength values based on all stories. There is no specific tendency for the ratio of individual story concrete strength and building concrete strength. The ratios vary between 0.5 and 1.75. The variation is almost similar throughout the building height. It should be noted that the number of story buildings is limited. Therefore, the variation at the fifth story level seems low. The variability of both curing conditions and the use of unstandardized mixed in place concrete are the main reasons contributing to these differences.

6 Summary and conclusions

Concrete compressive strength is one of the most critical parameters that affect the seismic performance of reinforced concrete buildings. Therefore, accurate determination of this value is crucial for seismic evaluation. This study investigated the possibility of determination of the concrete compressive strength of existing buildings using lower number of core samples. The experimental results of core samples taken from 148 slightly or moderately damaged reinforced concrete buildings during 2011 Simav Earthquake as a part of joint project by Pamukkale University and the Disaster and Emergency Management Presidency was used. As the majority of the buildings were constructed before 1970, the concrete compressive strength values are 14 MPa that corresponds to B160 concrete for residential buildings. Concrete for these buildings was generally produced using hand-mixed techniques. Concrete compressive strength values of samples were determined by taking 3 core samples from each story required in Turkish Earthquake Code (TCEC 2007) for the moderate level knowledge. Fifteen sets were formed by randomly selecting 50% and 70% of number of the core samples taken and the obtained compressive strength values were compared to the compressive strength value of the building based on all core samples. The results are summarized as below:

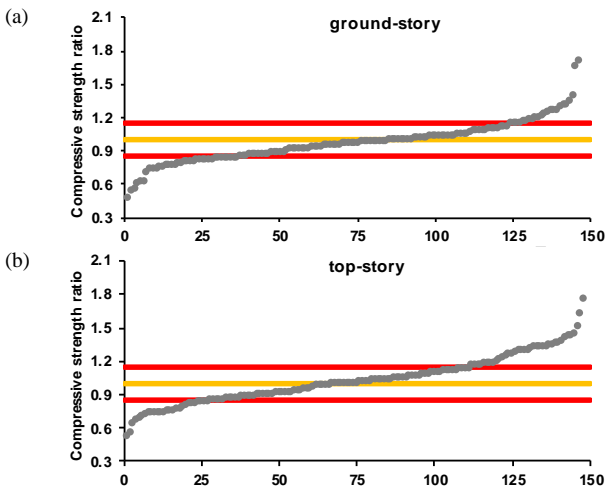


Figure 7 Distribution of concrete compressive strength in ground story (a) and top story (b) versus average concrete compressive strength for the building (each data on horizontal axis represent a building with increasing compressive strength ratio)

- § Majority of buildings has concrete compressive strength values lower than 10 MPa. Considering the fact that the concrete was prepared using handmade techniques without reference to any standard during the construction of these buildings, concrete compressive strength values are predictable.
- § The estimates of concrete strength values using 50% and 70% of the required core samples illustrates that the variation in concrete compressive strength estimates improve as the number of core samples increases.
- § The use of 70% of required number of core samples the seismic codes can successfully estimate the average compressive strength of buildings with 15% deviation for all concrete strength values obtained in the study (4.2 MPa). However, the use of 50% of the required samples provides successful estimated for

the concrete strength values equal to or higher than 8 MPa.

- § It is recommended that the use of %50 of the required core samples is possible for the rapid assessment or large-scale field investigation studies when the obtained concrete strength is equal to or greater than 8 MPa. However, additional core samples to take 70% of the code required samples are required for concrete strength values lower than 8 MPa.
- § While the forecast success of 70% of core samples with 15% aberration rate, it is calculated 59% when only base story considered.
- § Thus, taking less number of core samples from whole stories is better approach then considering-single story.
- § When the average compressive strength values for each individual storey are compared to the average concrete strength of the building there is no specific tendency. The variability of both curing conditions and the use of unstandardized mixed in place concrete are considered to be the main reasons contributing to the variation.
- § Considering the scatter and the values observed in this study, it is hard to say that the concrete compressive strength values based on a single core samples are reliable. The outcomes indicate that taking core samples from specific story as described in Turkish Risky Buildings Detection Code [6] may be inadequate to reflect the concrete compressive strength of building. Instead of taking core samples from a single story, the use 50% or 70% of the code required core samples from all stories is much more effective and reliable.

7 Acknowledgement

The core sample values used in this study are taken from study by Inel et al. (2011) which is supported financially by Republic of Turkey Prime Ministry Disaster and Emergency Management Presidency

8 References

[1] # ¶ © j a fl " Ł a j " ! " the Main Parameters Affecting Seismic Performance of the RC " ± ¥ " Ÿ Sadhana - Academy Proceedings in Engineering Science 39(2), 437-450, 2014

[2] " ¥ a ¥ œ ¥ fl " . s £ s ° s µ Ł " Ž s " s a fl " i " ¶ j © ¥ © j a ° s " " ° ± Ÿ µ « a " Effect of Various Factors on Compressive Strength " « a œ © Pamukkale University Journal of Engineering Sciences 6(3), 202-209, 2000.

[3] FEMA- " \$ ® j " ° s a Ÿ s ® ° " s a Ÿ " œ « " j ¥ " © ¥ œ " ® j ± s > ¥ " ¥ ° Sede Yak " Emergency " ± ¥ Management Agency Washington, 2000.

[4] " i a " i ± ® s i g n e o f f structures for earthquake " j " - ¥ " ° s a œ j " \$ s ® " " i " - " © j a " ° s " Comité Européen de Normalisation, Bruxelles, 2004.

[5] Turkish Earthquake Code (" i " " " - j œ ¥ " « ® " > ± ¥ " Ÿ ¥ a £ " " ° « " " j Ministry of Public ¥ a " " Works and Settlement Ankara (in Turkish), 2007.

[6] Turkish Risky Buildings Detection Code " " " (± j " « " Ministry of Environment and Urbanisation Ankara 2012 (in Turkish).

[7] Inel M, Un H, Ozmen HB, Akyol E, Cayci BT, Ozcan G. " Ł a 2 j " ° ¥ £ s ° ¥ « a « Ç " ° ± j " Ç j s " - ¥ > ¥ " ¥ Ÿ s © s £ j Ÿ " > ± ¥ " Ÿ ¥ a £ " " ° ¥ a " " ¥ Report ® j £ ¥ for Disaster and Emergency Management Presidency, Turkey, 2011.

[8] Google Maps (2011) <http://maps.google.com/>

[9] Disaster and Emergency Management Presidency " i ! \$ " " ± ¥ " Ÿ ¥ a £ " Ÿ s © s £ j " ® j " ± " ° " " "

[10] Ozmen, HB, Inel M, Akyol E, Cayci BT, Un H. " i 2 s " ± s ° ¥ « Relation of RC Building Damages with " s ® ° ± - Nautilus Hazards 71(1), 2014.

[11] " Ł a j " " ! " # ¶ © j a " fl " " " s µ « " " building damages after 19 May 2011 Simav (Turkey) " j s ® ° ± - Bulletin of Earthquake Engineering 11(1) 255-283, 2013.

[12] Turkish Earthquake Code " - j œ ¥ œ s ° ¥ « a " buildings to be built in seismic areas " Ministry of Public Works and Settlement Ankara 1998 (in Turkish).

[13] (" " " " (j " " " ! j - " Obtaining " « ® " Samples and Determination of Compressive Strength in Hardened Concrete in Structures and Components " j " " ° ± œ ° ¥ Turkish Standards Institution Ankara, 1992.

[14] ASTM C42/C 42M " " " ° s a Ÿ s ® œ d for j " " Obtaining and Testing Drilled Cores and Sawed Beams of " « a œ © ASTM 1999.